



# Horton Automatics



A Division of Overhead Door Corporation  
 4242 Baldwin Boulevard  
 Corpus Christi, Texas 78405-3399  
 512-888-5591 1-800-531-3111

## C7220-1 STRIKE INTERFACE MODULE

11015.0

APR94

CONTACTS RATED  
 10A @ 28VDC RESISTIVE

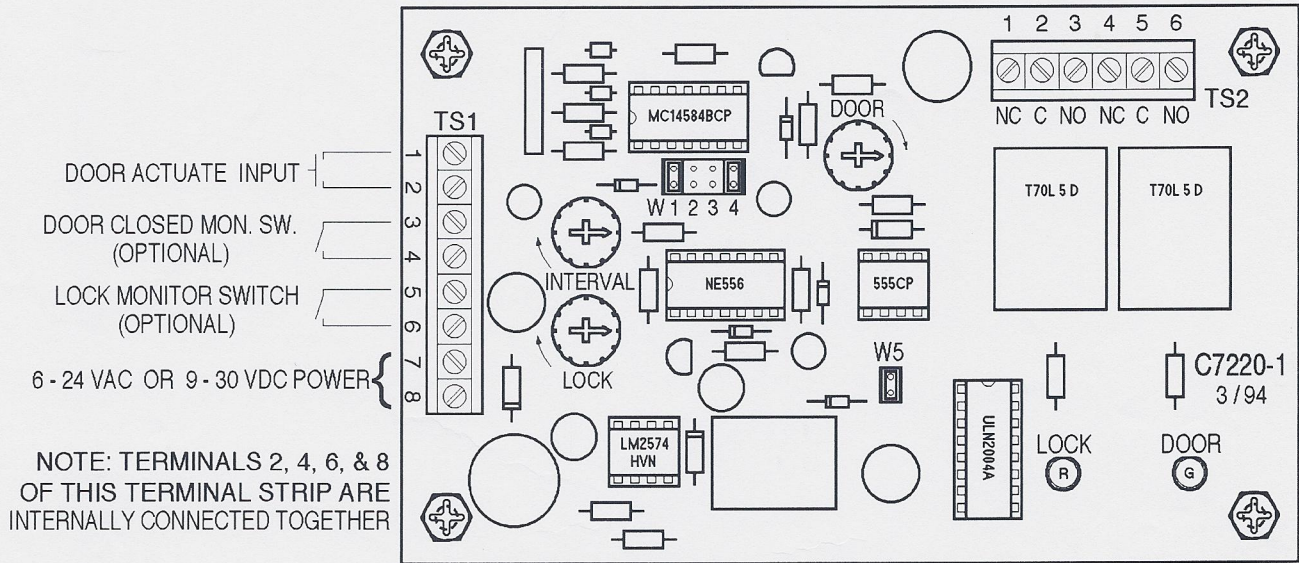

NOTE: TERMINALS 2, 4, 6, & 8 OF THIS TERMINAL STRIP ARE INTERNALLY CONNECTED TOGETHER

**INTERVAL DELAY (1/4 - 3 SEC.)** - ADJUSTS DELAY BETWEEN ACTUATION OF LOCK AND ACTUATION OF DOOR.

**DOOR DELAY (1 - 29 SEC.)** - ADJUSTS TIME DOOR WILL REMAIN ACTUATED AFTER RELEASE OF DOOR ACTUATE INPUT SIGNAL.

**LOCK DELAY (1 - 14 SEC.)** - ADJUSTS DELAY BETWEEN RELEASE OF DOOR ACTUATE SIGNAL AND RELEASE OF LOCK UNLOCK SIGNAL.


**JUMPER STRAPS:**

**W1, 2, 3, 4** - DETERMINE USAGE OF DOOR POSITION AND LOCK POSITION MONITOR SWITCHES. WITH STRAPS IN **W1** AND **W4** (DEFAULT) NO EXTERNAL MONITOR SWITCHES ARE REQUIRED.

**DOOR CLOSED MONITOR SWITCH** - IF CONTACTS CLOSE WHEN DOOR IS OPEN, STRAP **W4**; IF CLOSED WHEN DOOR CLOSED, MOVE STRAP FROM **W4** TO **W3**.

**LOCK MONITOR SWITCH** - IF CONTACTS CLOSE WHEN LOCK IS UNLOCKED, STRAP **W1**; IF CLOSED WHEN LOCK IS LOCKED, MOVE STRAP FROM **W1** TO **W2**.

**W5** - IF STRAP IS PRESENT, LOCK WILL REMAIN UNLOCKED FOR DURATION OF INTERVAL, DOOR, AND LOCK TIMERS. IF STRAP IS REMOVED, LOCK WILL REMAIN UNLOCKED FOR DURATION OF INTERVAL AND LOCK TIMERS ONLY; IT WILL BE RELEASED FOR BALANCE OF DOOR TIMER (USEFUL FOR NOISY LOCKS).



**Horton Automatics**  
4242 Baldwin Blvd.  
Corpus Christi, Texas 78405  
(512) 888 - 5591 1-800-531-3111  
Fax No. 1-512-888-6510

# C7215 SIMULTANEOUS ACTUATION MODULE TYPICAL WIRING

MAY'91

